


Experiment for operational confirmation of on-site thermal performance measurement system for multi-chamber buildings

Thermal performance measurement system for multi-chamber buildings




Electric heating control device

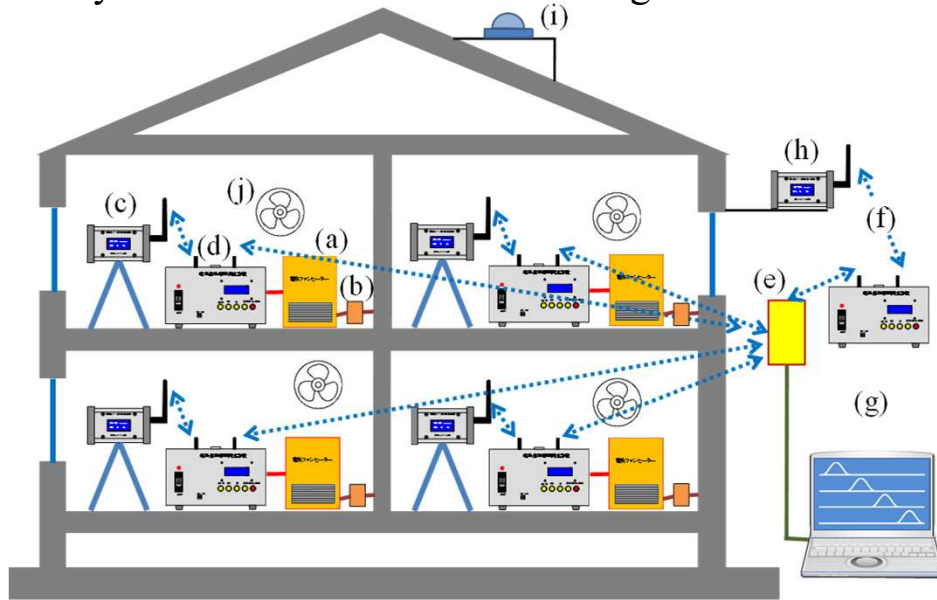

Temperature/ Humidity measuring device



Heat generation control/ Measurement/ Recording PC

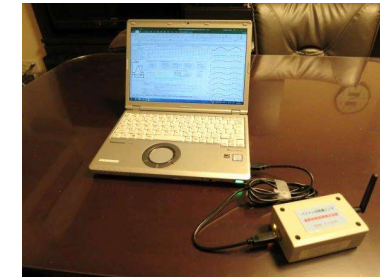

Electric heater and Stirrer



Prototyped by support from Grants-in-Aid for Scientific Research

3LDK, 4th floor, Apartment complex in Yokohama:
Floor area 66m², interior volume 138m³



The measurement period is 4 days from 18:10 on Nov. 14, to 18:10 on Nov. 18, 2018

